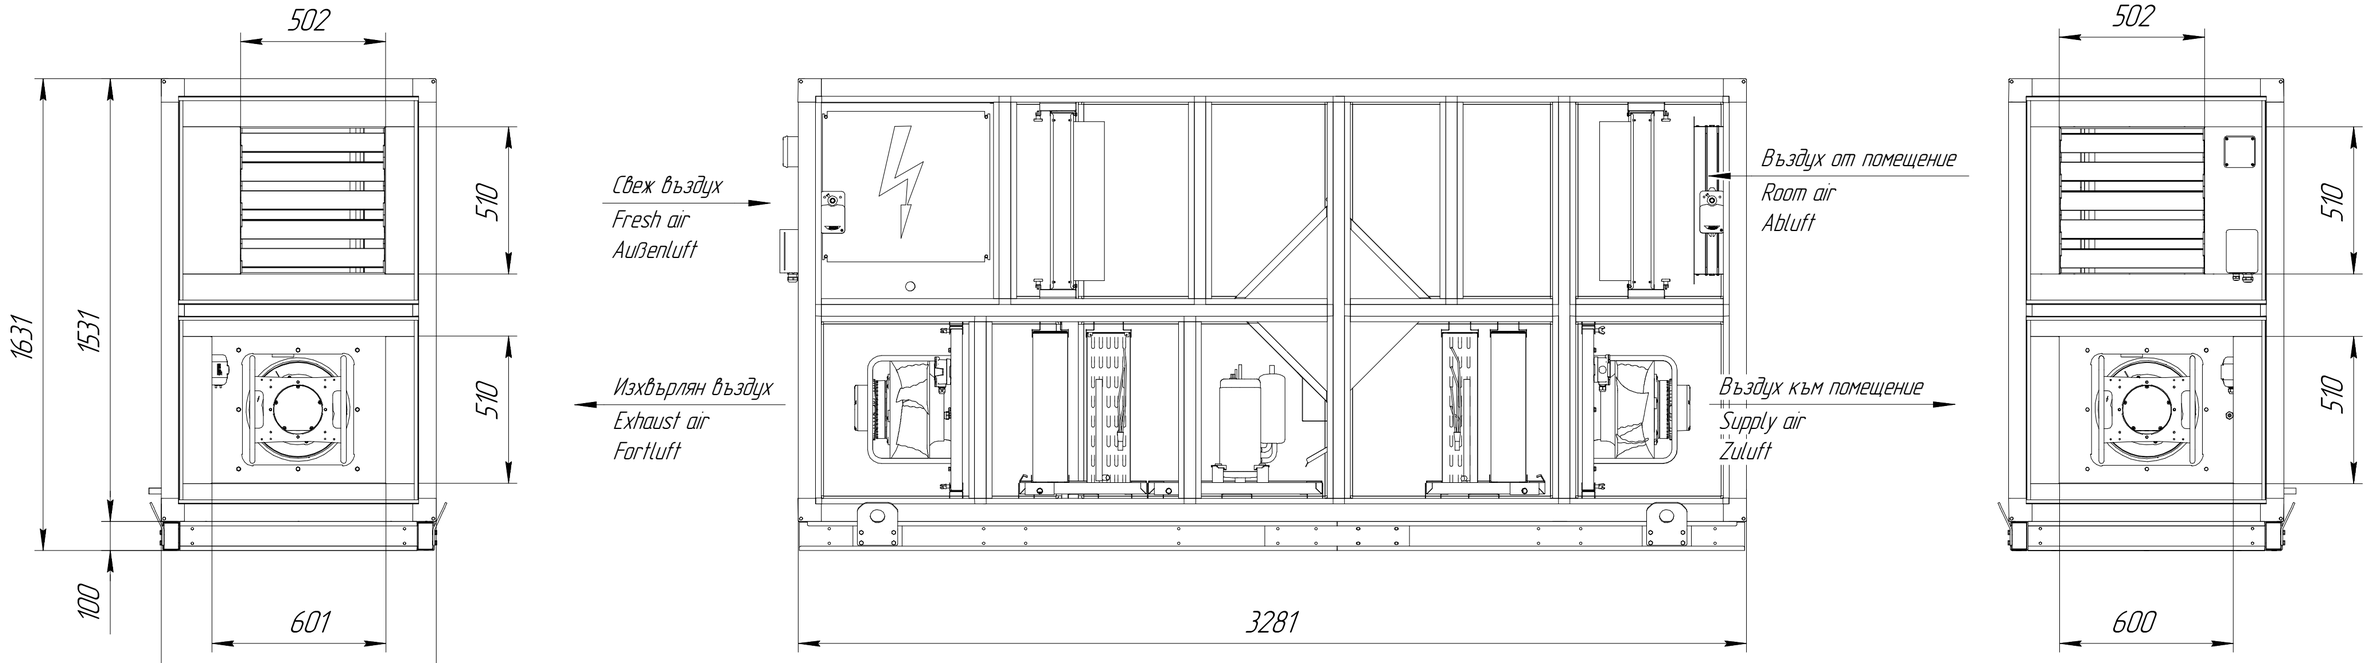

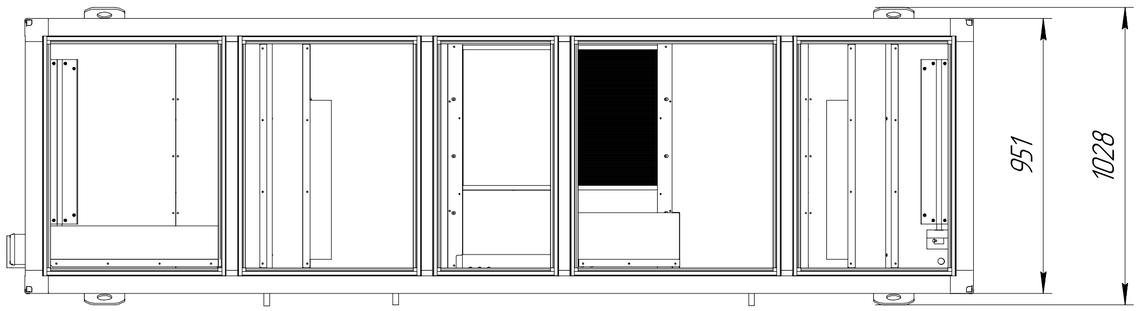

Страна на обслужване
Service side
Bedienseite

BG:
1. От страна на обслужване да се осигури минимално разстояние 1200 mm.
2. Всички надписи са на Български, Английски и Немски език.
3. Всички размери са посочени в mm.

Забележка:
Моля, предвидете достатъчна височина на носещата конструкция(фундамент) на климатичната камера , за нормален монтаж на хидрозатворите.

DE:
1. 1200 mm Abstand sind von der Bedienseite freizuhalten.
2. Alle Beschriftungen sind auf Bulgarisch, Englisch und Deutsch.
3. Alle Abmessungen sind in mm.

Bemerkung:
Bitte beachten Sie die Höhe der Unterkonstruktion des Lüftungsgerätes, um eine korrekte Installation der Siphons zu gewährleisten.

Попълва се от клиента! To be filled by the client! Vom Kunden auszufüllen!

☐ Външен монтаж Outside mounting Außenmontage ☐ Вътрешен монтаж Inside mounting Innenmontage	ОДОБРЕНО ОТ APPROVED BY GENEHMIGT DURCH	
	Име / Name / Name	
	Подпис / Signature / Unterschrift	
	Дата / Date / Datum	Печат / Stamp / Stempel

EN:
1. 1200 mm distance must be provided from service side.
2. All inscriptions are in Bulgarian, English and German.
3. All dimensions are in mm.

Note:
Please, consider the height of supporting construction of the AHU to ensure correct installation of siphons.

	No doc	Signature	Date
Developed			
Verified			

max e2 -02 PS R

State	Mass	Scale
		no
Sheet	All sheets 1	

Damvent
to reach...and exceed